


Mark Gipson


Water Wastewater Services Engineer




Sanitary Work – College to Columbia

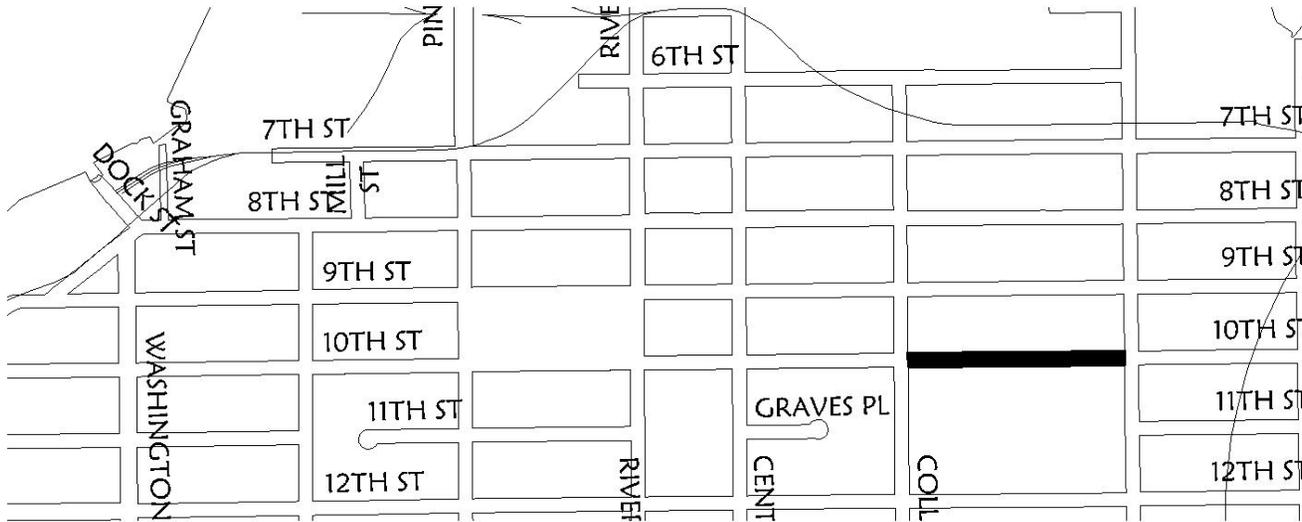

Water Main Work – Lincoln to Columbia

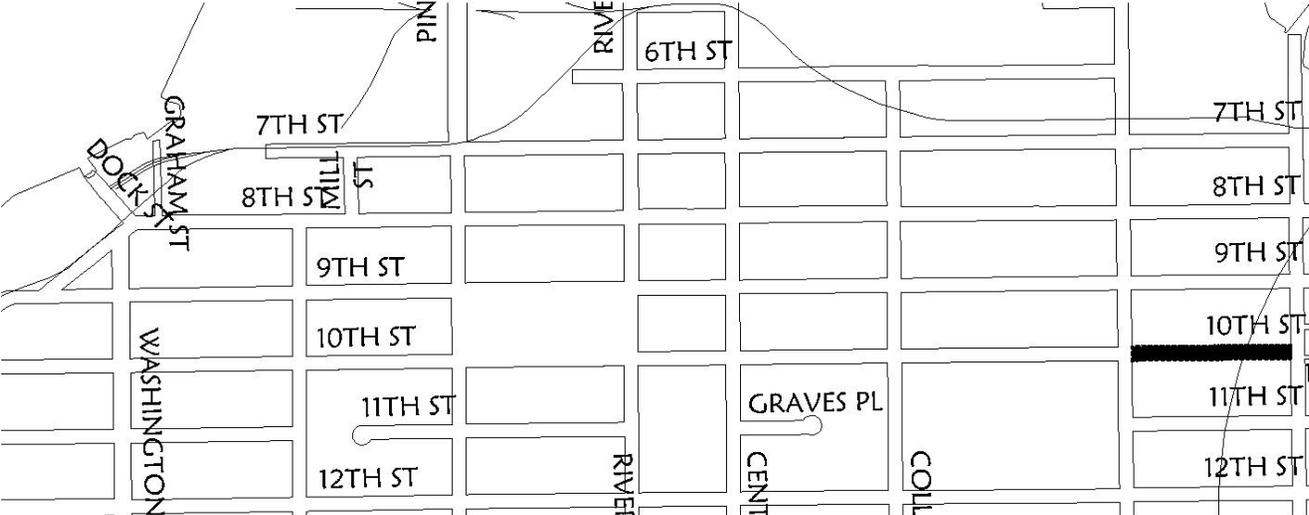


Water Service Work – at various locations

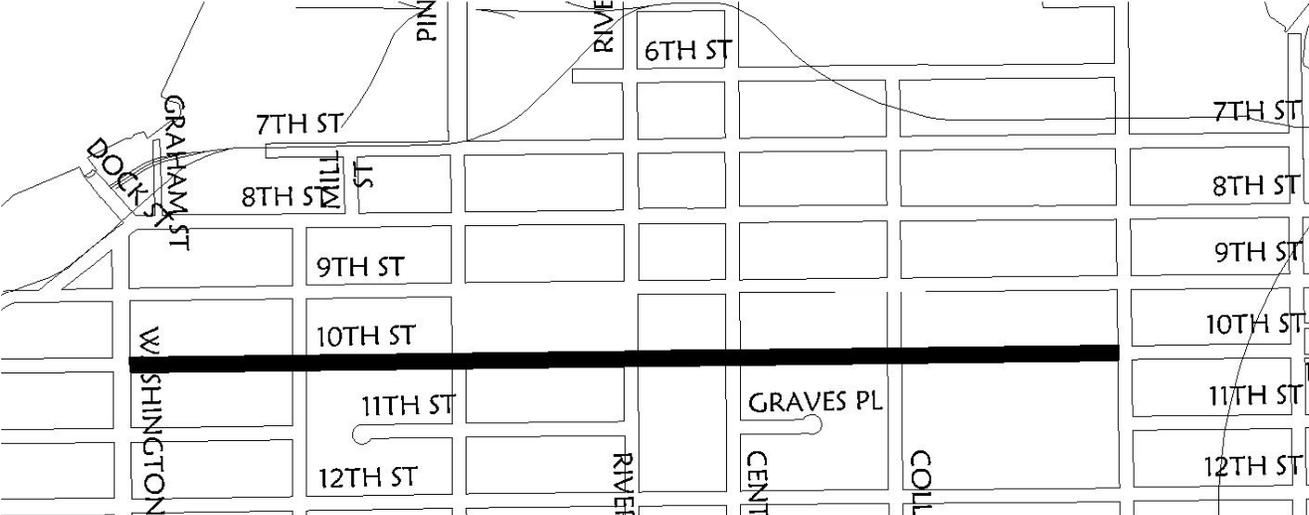

Water Service Replacement

- Revised Lead and Copper rule mandates BPW replacement of galvanized service from the main to the meter.
- Owner must agree to have the work completed
- Access to the home will be required at least twice to complete replacement.
- Water service may be relocated to facilitate replacement

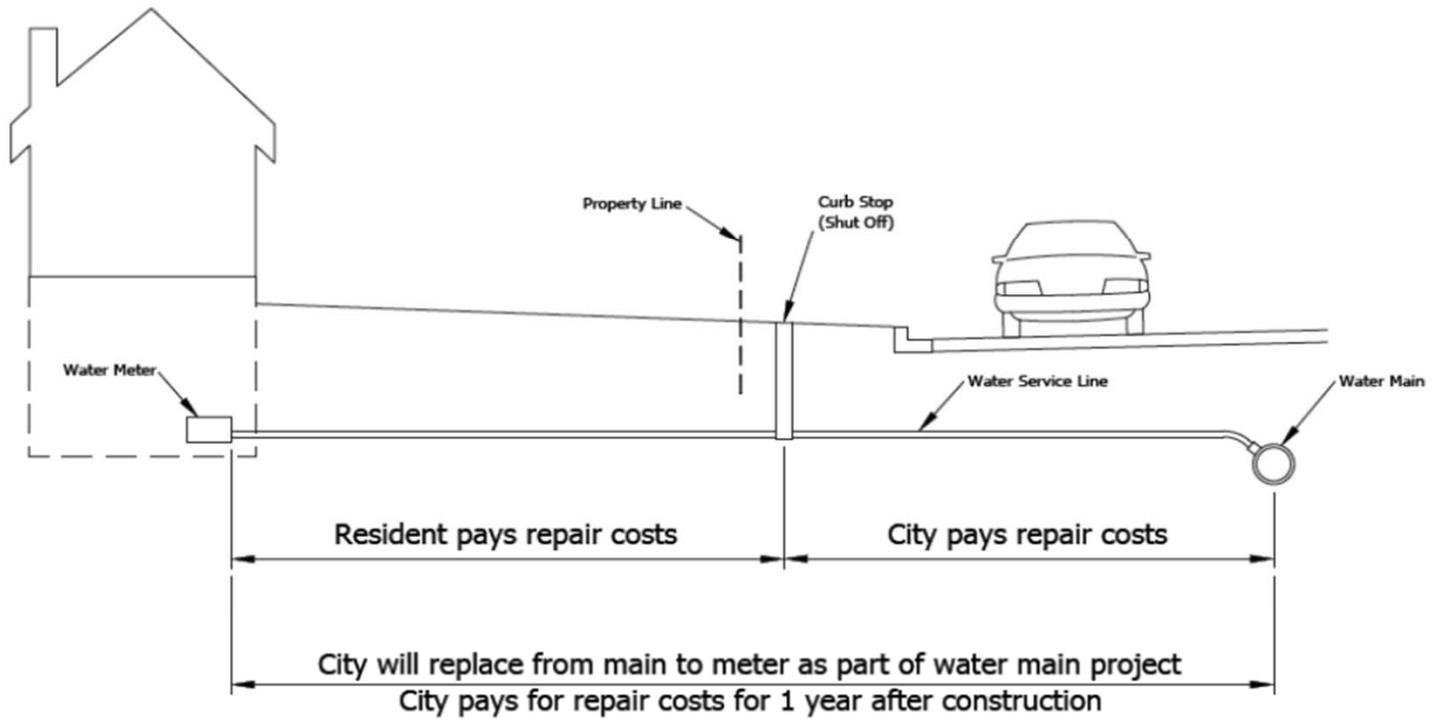

Water Service Replacement

